




32
 HP UNITS
 SCALE: 3" = 1'-0"

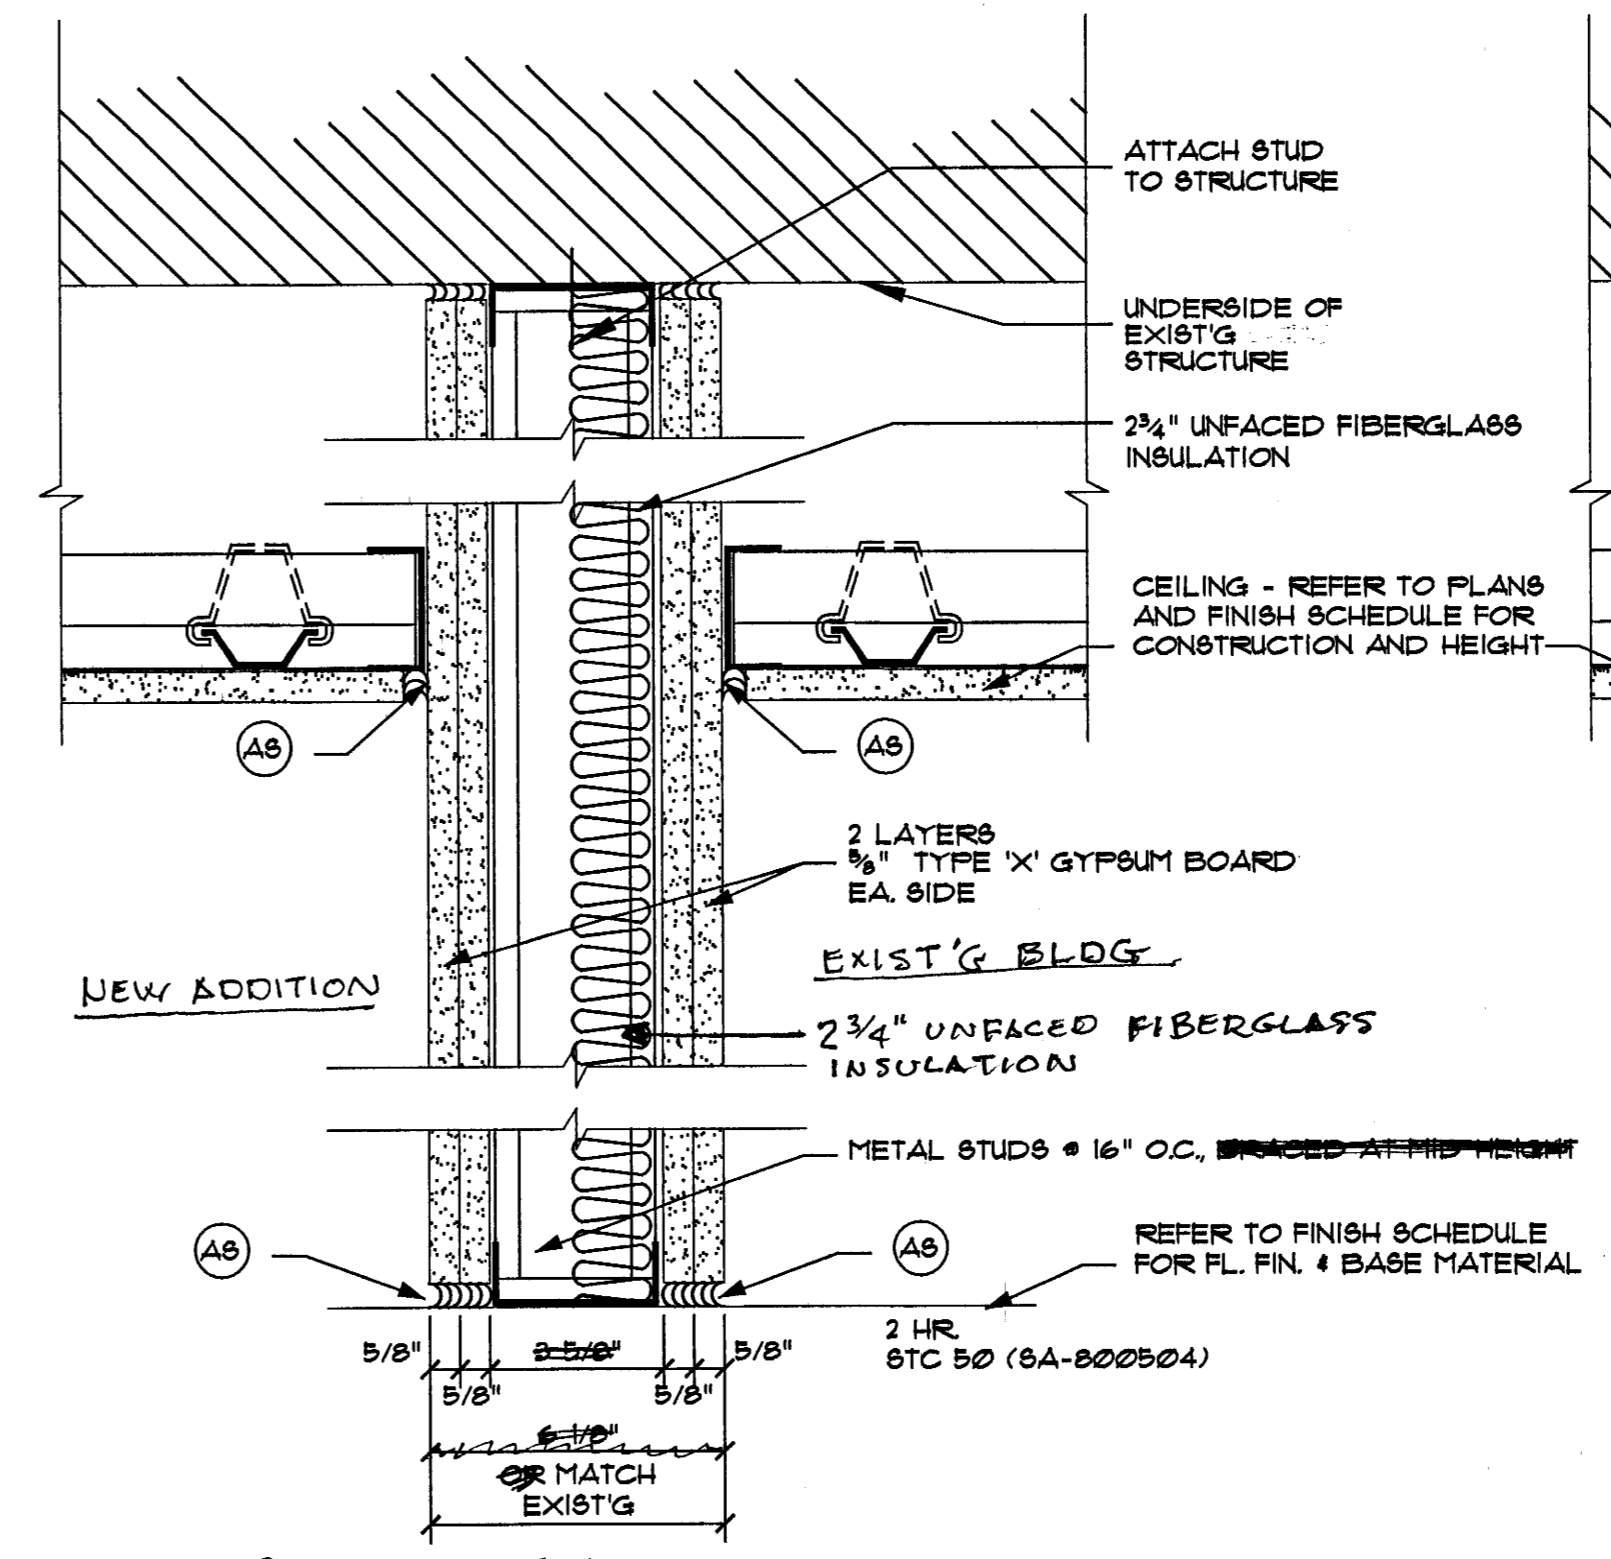

22
 INFILL NEW PARTN AT EXIST'G EXTERIOR WALL
 FIREPROOF STOR RM.
 N.T.S.

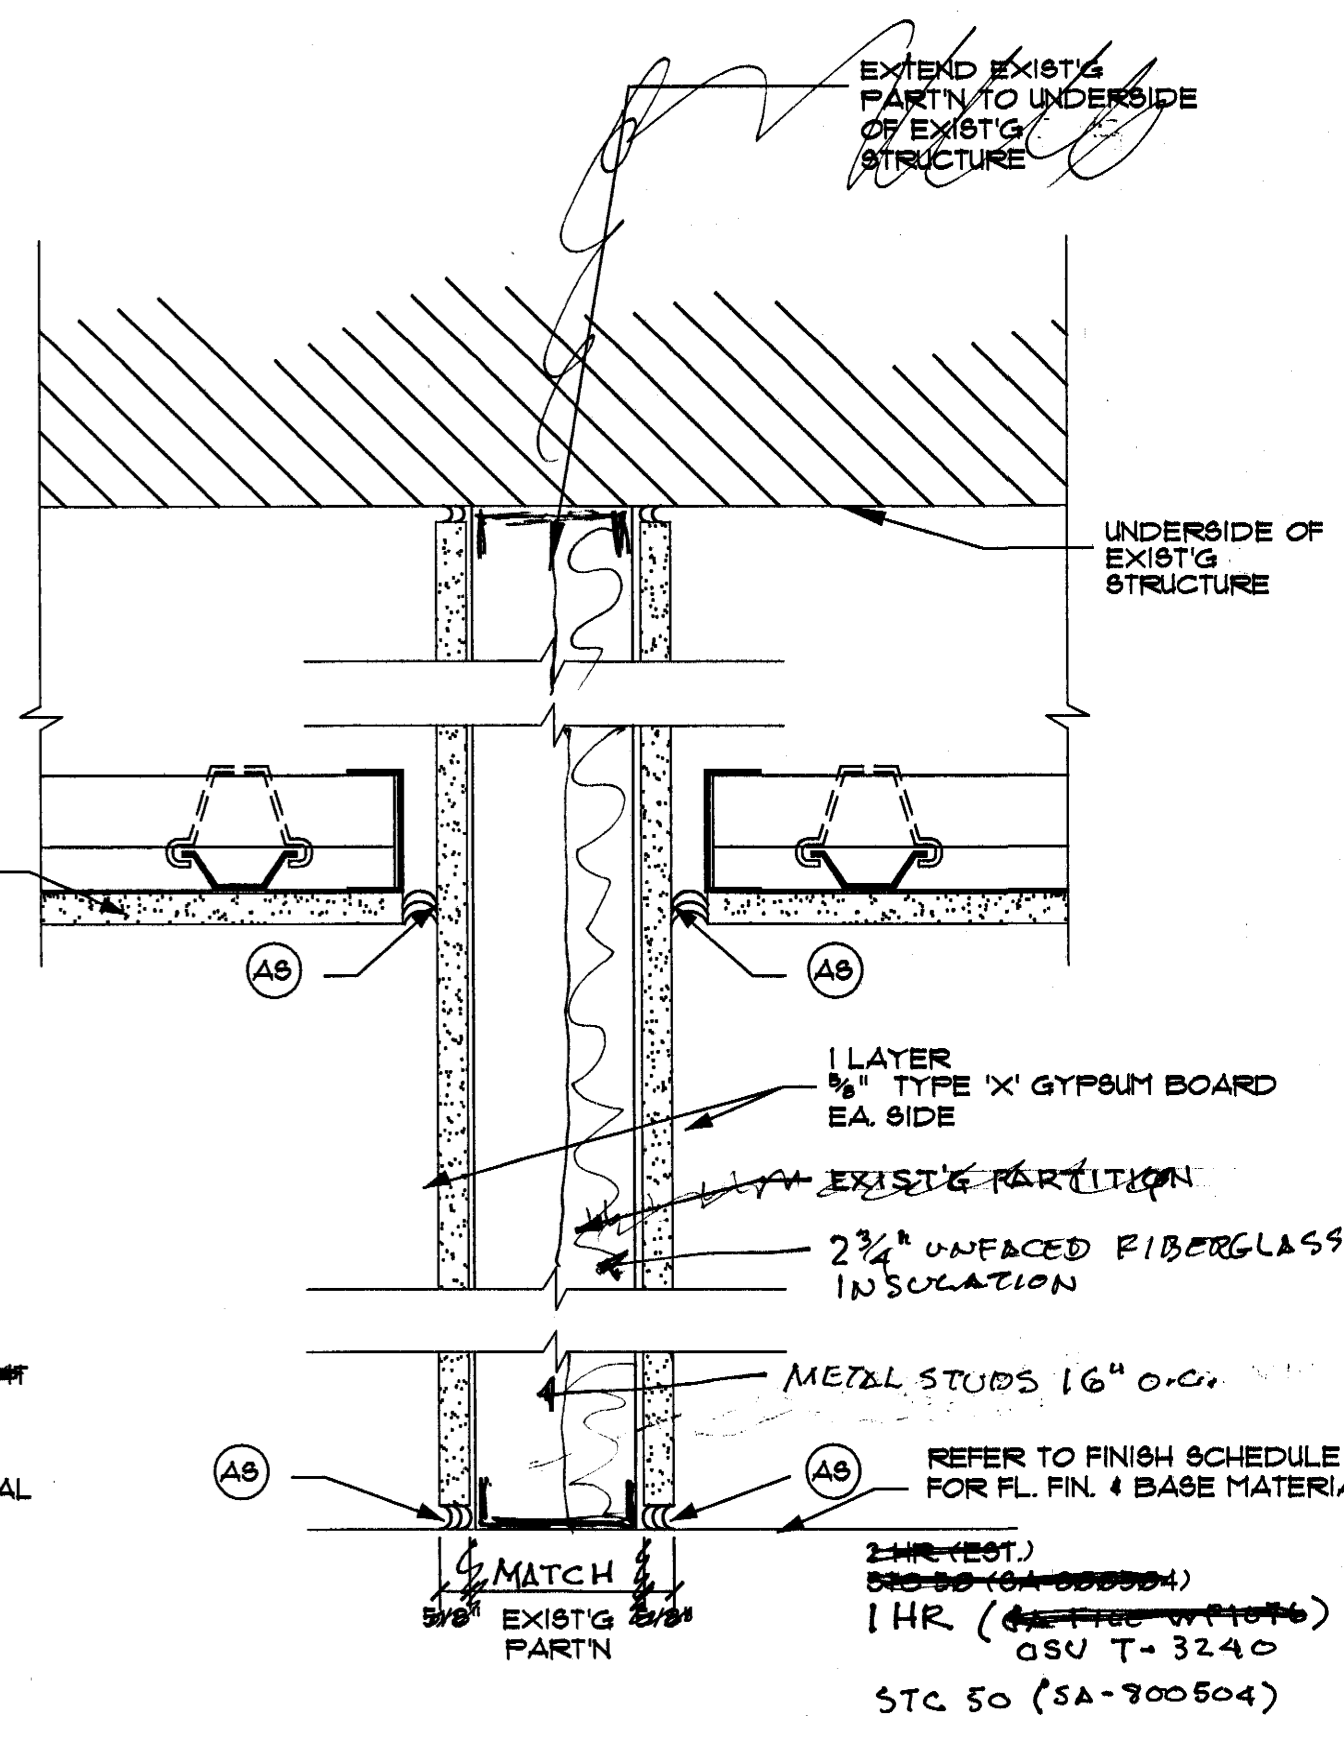


12
 INFILL EXIST'G PARTN AT
 FIREPROOF STOR RM.
 N.T.S.

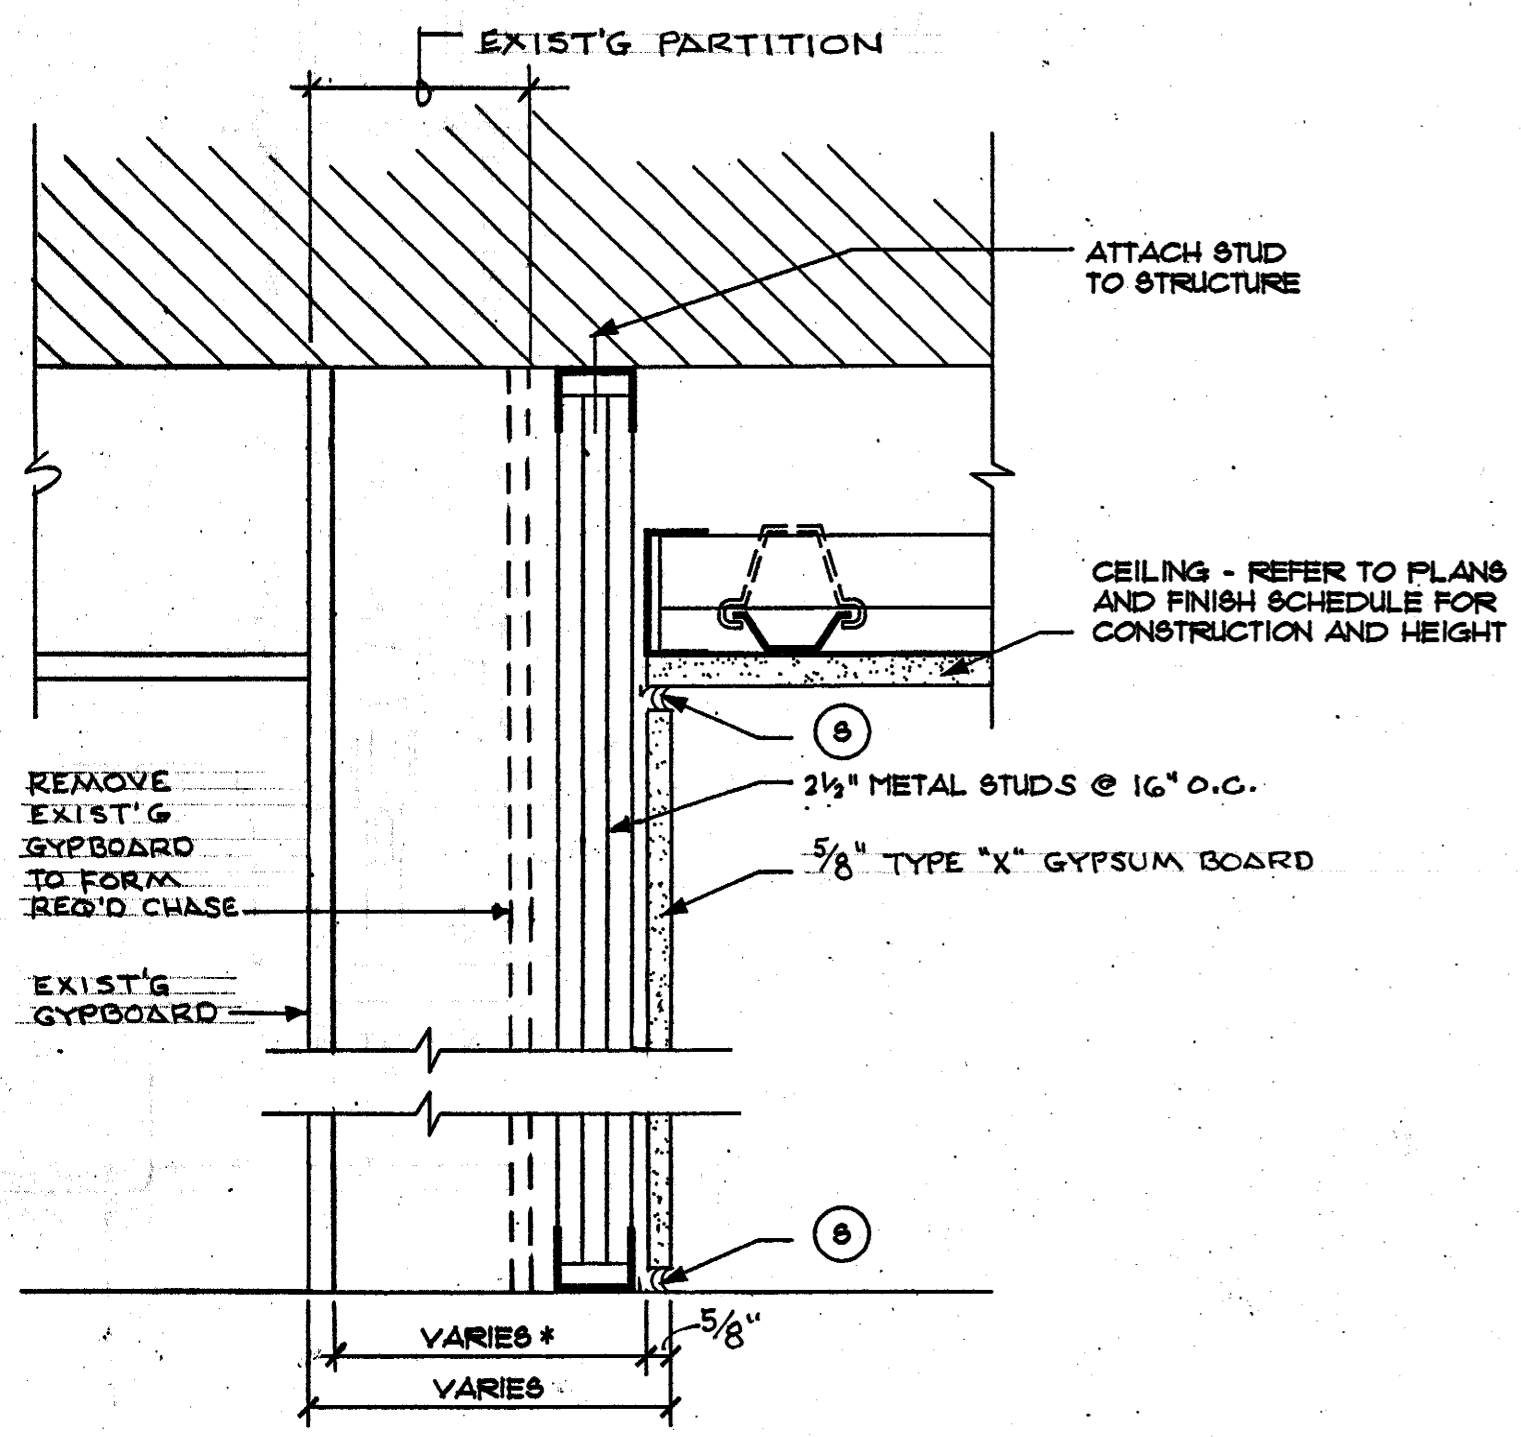


* (MIN. DEPTH AS REQD. BY PLUMBING & HVAC)

41
 CHASE
 SCALE: 3" = 1'-0"

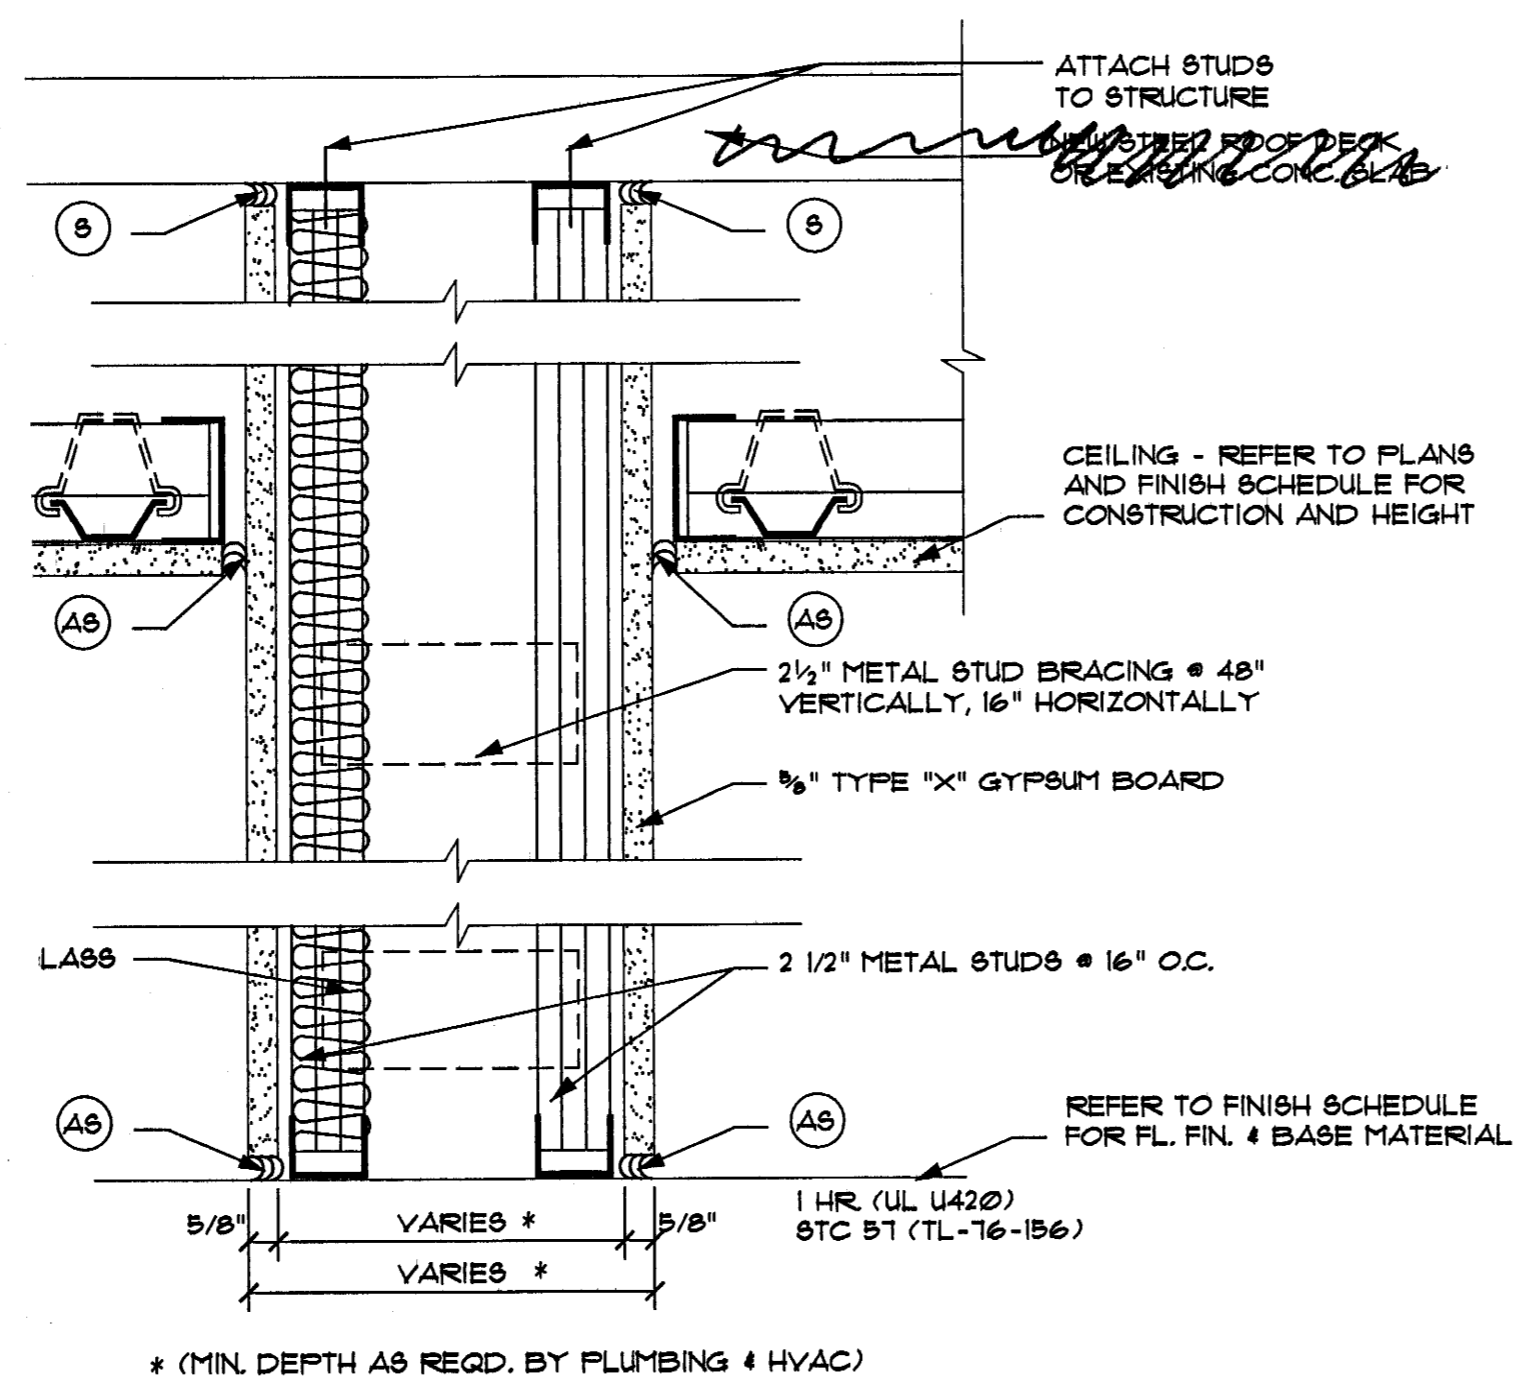


* (MIN. DEPTH AS REQD. BY PLUMBING & HVAC)

31
 CHASE ADDITION AND NEW HP
 N.T.S.

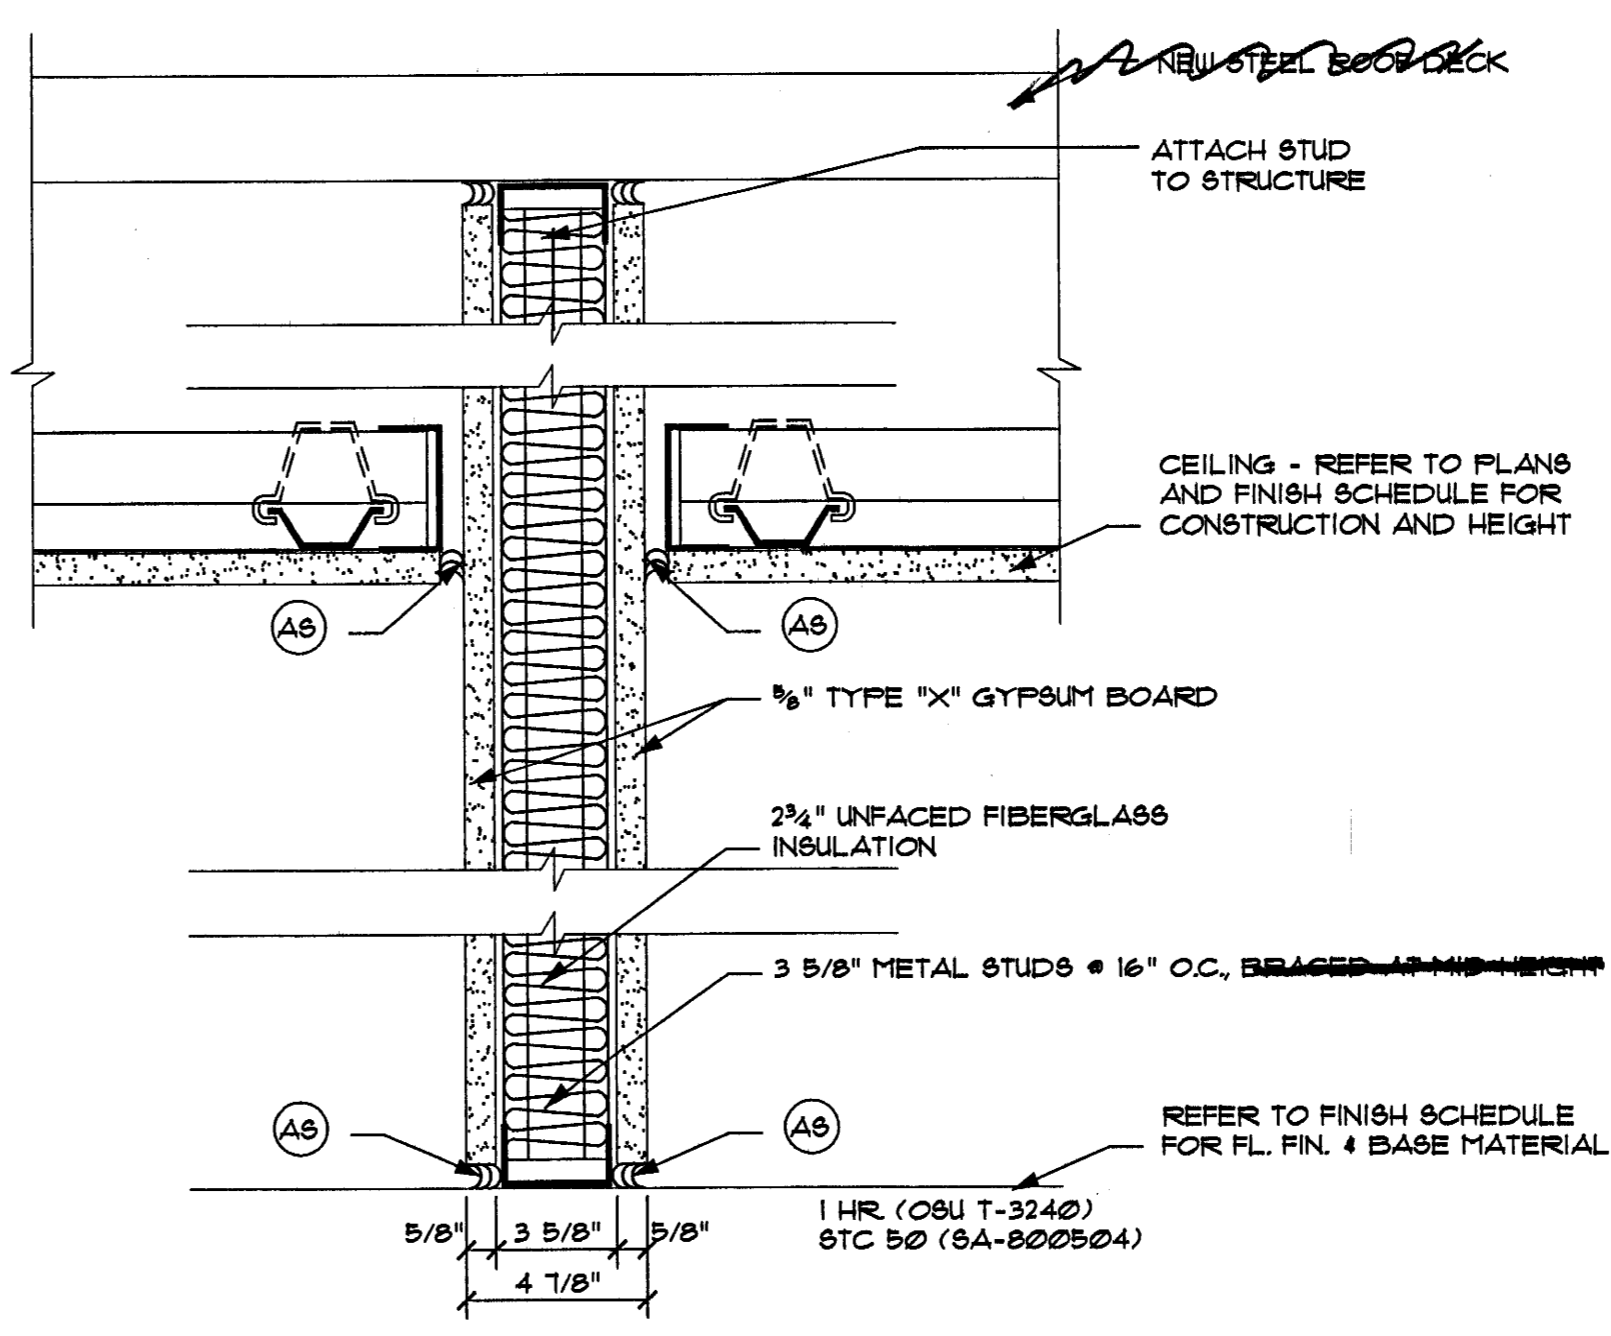

21
 KITCHEN AND TOILETS AT ADDITION & HAIRDRESSER
 N.T.S.

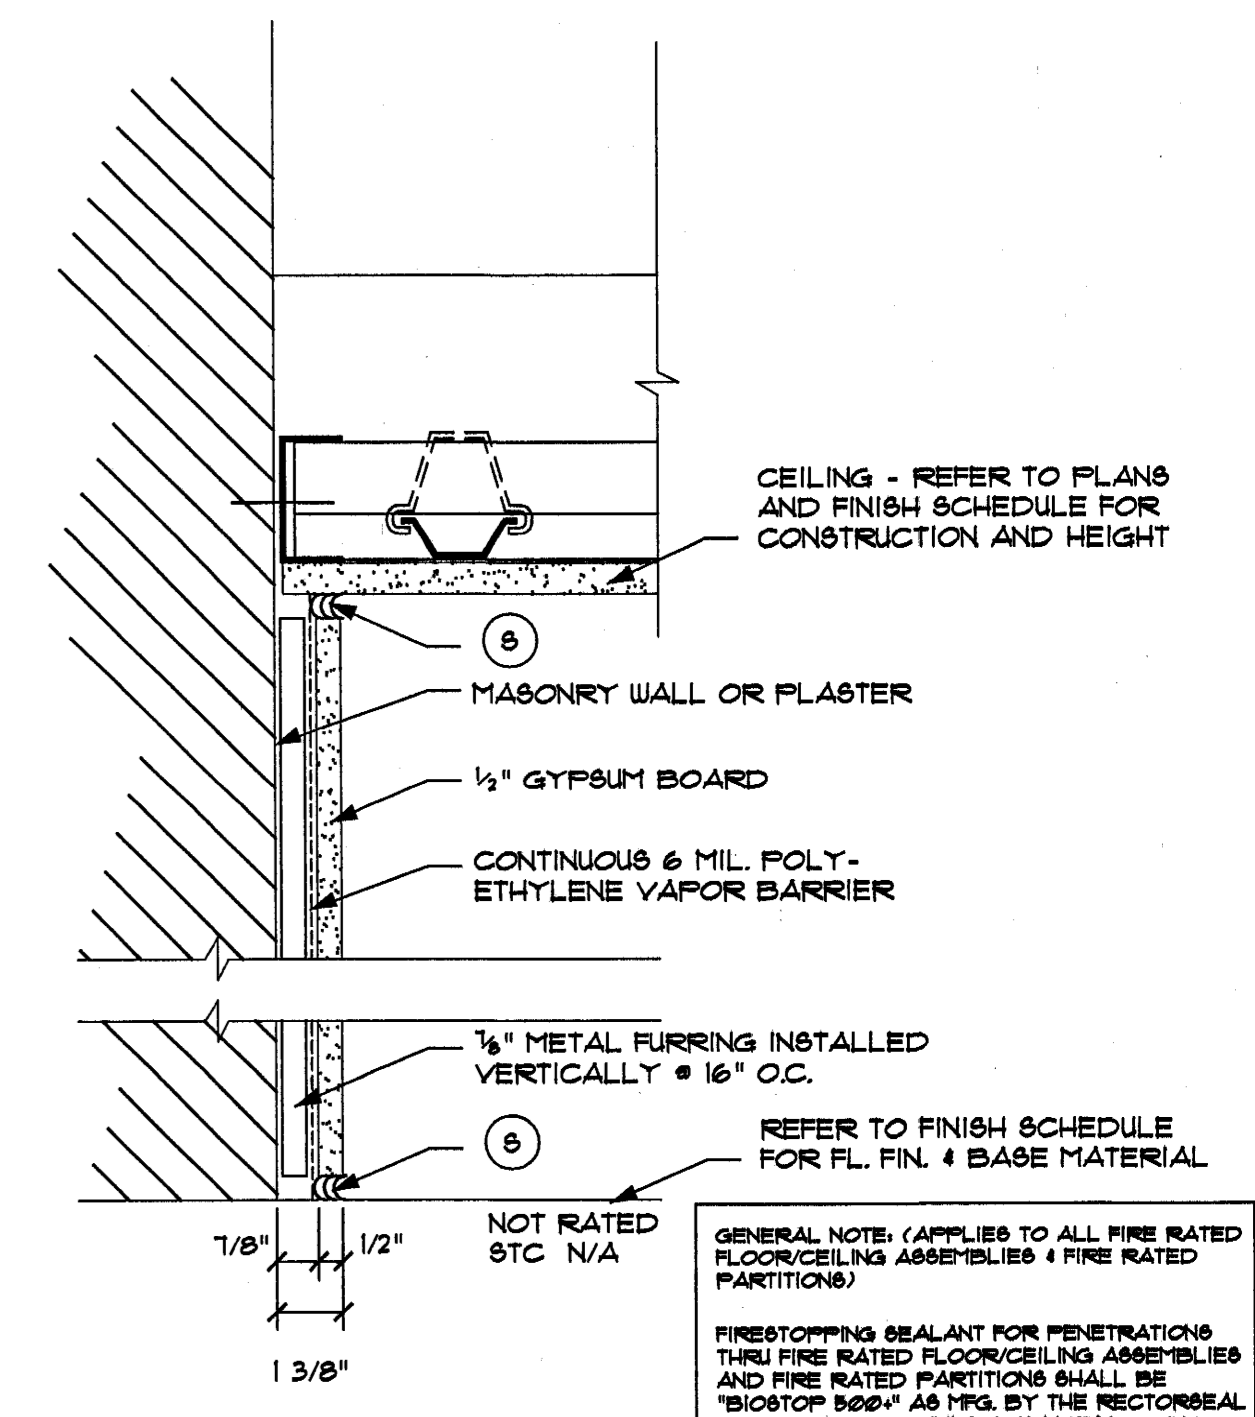

GENERAL NOTE: (APPLIES TO ALL FIRE RATED FLOOR/CEILING ASSEMBLIES & FIRE RATED PARTITIONS)
 FIRESTOPPING SEALANT FOR PENETRATIONS THRU FIRE RATED FLOOR/CEILING ASSEMBLIES AND FIRE RATED PARTITIONS SHALL BE "BOSTOP 500" AS MFG BY THE RECTORS/BEAL CORPORATION INTUESCENT FIRESTOPPING.

11
 EXISTING MASONRY NEW ADDITION EXTERIOR WALL
 SCALE: 3" = 1'-0"